

Print Date : 29.01.2025

Print Time : 18:05:05

Print By : Initial User

Product Name : Esom EC 40 mg + Dom SR 30m

DR.REDDY'S LABORATORIES LTD

FTO Unit-3

M0001 - Batch Report - Thickness (mm)

Batch Date : 29.01.2025

Batch No : VT123

Product Code	200101341
Compression Equipment ID	M0001
Type of Rotary	Double
Cubicle Name	CGD
Vernier / Multitester ID	MM123
No of Stations	11

Batch Start Time	29.01.2025 17:59:48
Batch Stop Time	29.01.2025 18:02:55
Username	Initial User

S. No.	Start Time	Stop Time	Instrument ID	LHS Container No	RHS Container No	LSL	Target	USL	Min	Max	Avg	Result	UserName
1	29.01.2025 18:01:38	29.01.2025 18:01:39	MM123	EFR	NA	4.190	4.900	6.190	5.030	5.980	5.176	PASS	Jaisukh BK
2	29.01.2025 18:02:37	29.01.2025 18:02:39	MM123	NA	defv	4.190	4.900	6.190	5.030	5.980	5.176	PASS	Jaisukh BK
3	29.01.2025 18:01:38	29.01.2025 18:01:39	MM123	EFR	NA	4.190	4.900	6.190	5.030	5.980	5.176	PASS	Jaisukh BK
4	29.01.2025 18:02:37	29.01.2025 18:02:39	MM123	NA	defv	4.190	4.900	6.190	5.030	5.980	5.176	PASS	Jaisukh BK

Avg Of Avg	5.176
------------	-------



Checked By :

*NA-Not applicable

Print Date : 29.01.2025
Print Time : 18:05:05
Print By : Initial User
Product Name : Esom EC 40 mg + Dom SR 30m

DR.REDDY'S LABORATORIES LTD
FTO Unit-3
M0001 - Batch Report - Thickness (mm)

Batch Date : 29.01.2025
Batch No : VT123

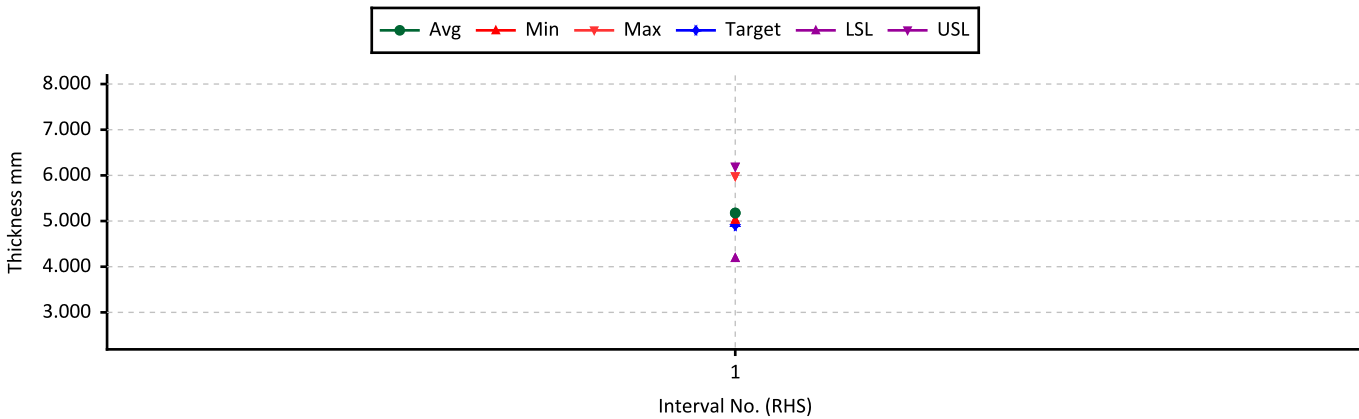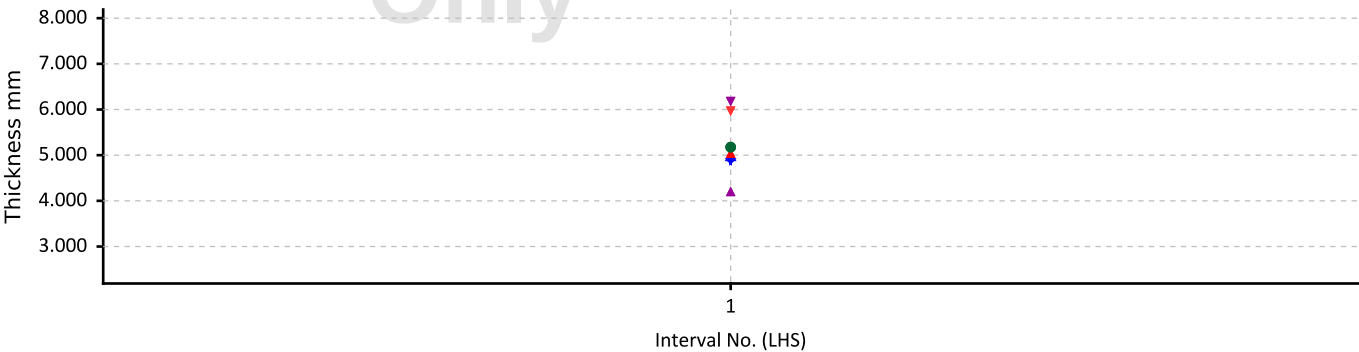

Checked By :

*NA-Not applicable